


MANUAL ACCESS GATE



NOTES:

- 1 APPROVED SIGN, WITH REFLECTIVE BACKGROUND, TO IDENTIFY THE NAME OF THE BUSINESS COMPLEX AND THE LOCATION OF THE ACCESS ENTRANCE.
- 2 PROPERTY OWNER/MANAGEMENT PADLOCK
- 3 FIRE DEPT. PADLOCK SHALL BE ACCESSIBLE FROM BOTH SIDES OF GATE.
- 4 APPROVED FIRE LANE SIGNS WITH REFLECTIVE BACKGROUND, PLACED BACK TO BACK AND FASTENED ON ALL 4 CORNERS.
- 5 6" PARKING LOT STRIPING AT THE LOCATIONS SHOWN ON CONCRETE CURBS AND APPLIED TO ASPHALT.
- 6 THE MINIMUM OVERALL CLEAR WIDTH OF THE GATE OPENING SHALL BE 20 FT.
- 7 WELD MODIFIED L-BRACKET TO GATE FRAME; ROUND ALL EDGES. (TYPICAL 2 PLACES)
- 8 LOCKING BAR LENGTH IS DETERMINED BY THE FRAME WIDTH AND THE GAP WIDTH BETWEEN THE 2 GATES. REMOVE ALL SHARP EDGES & ROUND ALL CORNERS.
- 9 APPROVED FIRE DEPT. ACCESS SIGN WITH WHITE 3M DIAMOND GRADE DG³ BACKGROUND PLACED BACK TO BACK.

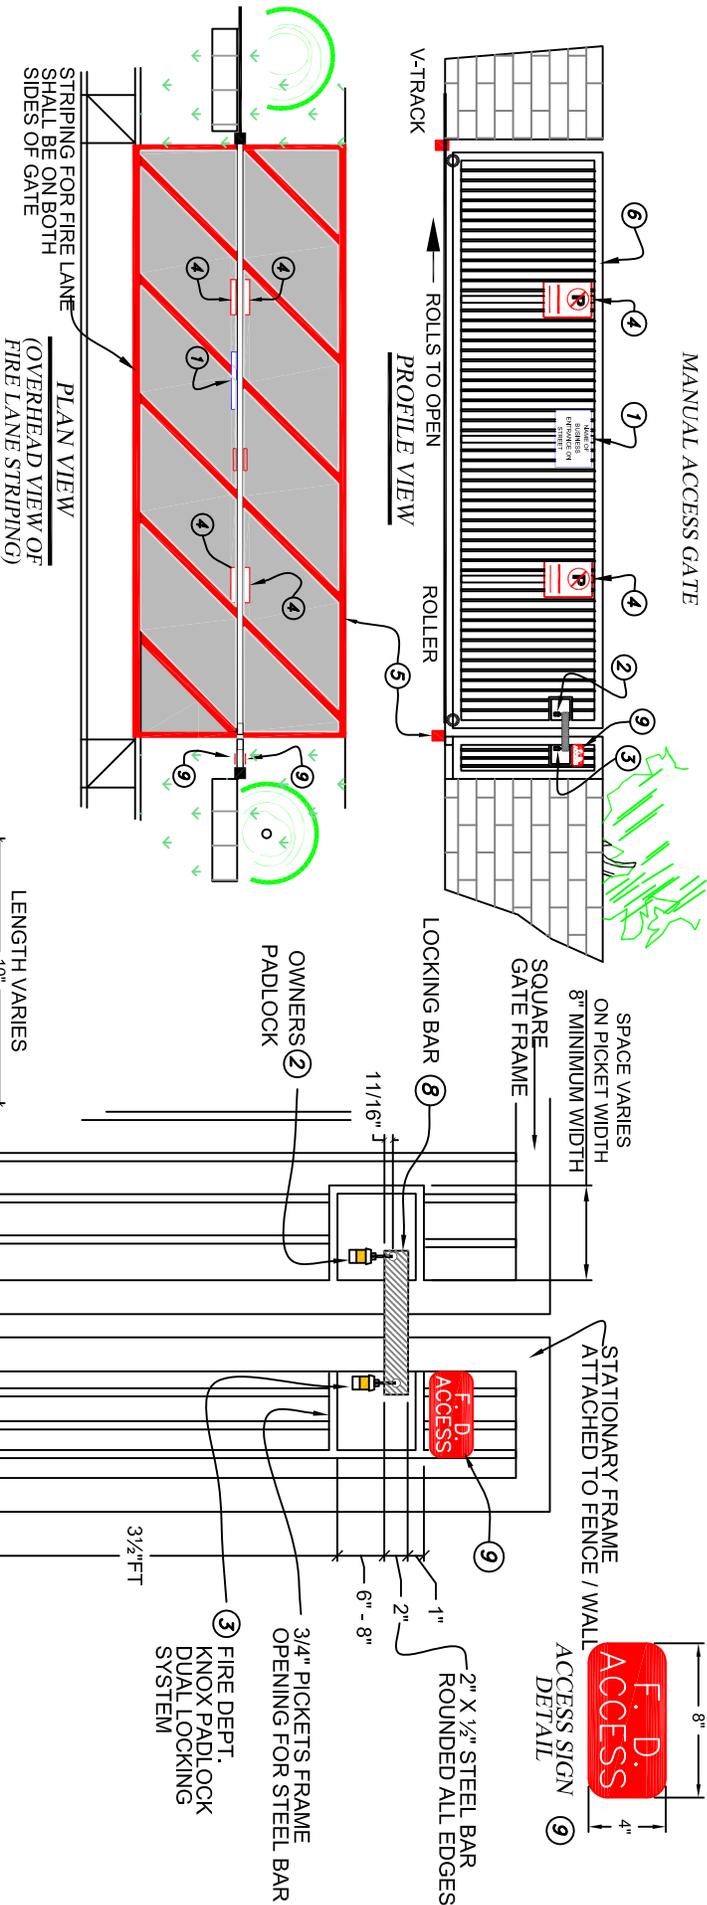